AX-GS-CD-T81G

Room Carbon dioxide Transmitter, Analogue output, Optional RH&T



Product overview

The AX-GS-CD-T81G Carbon Dioxide Transmitter uses Non-Dispersive Infrared (NDIR) technology to measure CO2 levels and provides an analogue output (voltage or current) corresponding to the measured value. The maximum level can be set to 2000 ppm or 5000 ppm using the on-board dipswitches. The optional multicolour LCD version can display CO2 levels in ppm and change backlight colour based on the measured CO2 value. It also has a version with additional Relative Humidity and Temperature outputs.

Applications: Indoor air quality monitoring and demand controlled ventilation systems where there is no full-time occupation.



Products Features

- Solid state sensing element
- No calibration required
- Voltage or current output

- 24V AC/DC supply voltage
- Digital display of CO2 levels in ppm (-MCD versions)
- Visual alarm indication with backlight colour switch (-MCD)

Product Specifications

| Carbon Dioxide Sensor | | | | | |
|-----------------------|-----------------------------|--|--|--|--|
| Power consumption: | 0.75W Typical. 1.5W Maximum | | | | |
| Power supply: | 24 Vac/dc $\pm 15\%$ | | | | |

<u>Carbon Dioxide Sensor</u>

| ttput range: 0-2000ppm/5000ppm selectable | | | | |
|---|--|--|--|--|
| Sensing method: | Non Dispersive Infrared | | | |
| Sampling type: | Diffusion | | | |
| Typical coverage area: | 15m radius or 700sq.m | | | |
| Accuracy: ± 30 ppm $\pm 3\%$ of reading | | | | |
| Stability: | <2% of FS over life of sensor | | | |
| Temperature dependence: | 5ppm per °C or 0.5% of reading per °C whichever is greater | | | |
| Sensor life expectancy: | 15 years typical | | | |
| Calibration interval: | Calibration not required. See ABC Logic | | | |
| Signal update interval: | Every 5 seconds | | | |
| Response time (t ₉₀): | < 3minutes | | | |
| Warm up time: | 10 minutes | | | |

Passive Temperature Output (optional)

| Sensor type: | See order codes for available passive sensor types |
|--------------|--|
| Accuracy | ±0.5°C typical |

RH&T Analog Outputs (optional)

| Sensor Type: | Capacitive | | | | |
|---------------------------------|--|--|--|--|--|
| Output range: | RH: 0to100%RH, Temperature: -10°C to 40°C | | | | |
| Accuracy | RH: ±2.5% typical (20 to 80% RH at 25°C) Temperature: ±0.3°C Typical | | | | |
| Response time | 15 seconds @25°C, but dependent on airflow | | | | |
| LCD Display (optional): | 4 digits 9mm high | | | | |
| | Backlight color: Red(>1500ppm)Orange(1000 to 1500ppm)/Green (<1000ppm) | | | | |
| Analogue Outputs: | 0-10Vdc / 4-20mA selectable using dipswitch | | | | |
| Maximum load: | 600 Ohms max for 4-20mA output. 5mA for Voltage output. | | | | |
| Enclosure: | ABS UL94-5VA compliant . Cool white colour. | | | | |
| Dimensions, weight and ingress: | 87 x 82 x 27mm, 75g, IP30 | | | | |
| Operating conditions: | -10°C to 50°C, 0 to 95%RH non-condensing | | | | |
| Storage conditions: | -20°C to 70°C | | | | |
| Compliance: | CE, RoHS | | | | |
| Country of origin: | United Kingdom | | | | |

AX-GS-CD-T81G

Room Carbon dioxide Transmitter, Analogue output, Optional RH&T



| Order Codes | | | | | |
|------------------------|--|--|--|--|--|
| Part Number | Description | | | | |
| AX-GS-CD-T81G-V | Room CO2 transmitter, 0-2000/5000ppm, 0-10V output | | | | |
| AX-GS-CD-T81G-VI | Room CO2 transmitter, 0-2000/5000ppm, 0-10V/4-20mA output | | | | |
| AX-GS-CD-T81G-VI-MCD | Room CO2 transmitter, 0-2000/5000ppm, 0-10V/4-20mA output with Multicolour LCD Display | | | | |
| AX-GS-CD-T81G-VI-H | Room CO2, RH &T transmitter, 0-2000/5000ppm, 0-10V/4-20mA output | | | | |
| AX-GS-CD-T81G-VI-H-MCD | Room CO2, RH &T transmitter, 0-2000/5000ppm, 0-10V/4-20mA output with Multicolour LCD | | | | |

| | T | 10K3A1 NTC | SAT | SAT1 NTC | 1K | PT1000a Platinum |
|---|----|------------|-----|-----------------|-----|---------------------|
| Add '-x' to the part numbers for additional | 3K | 3K3A1 NTC | ST1 | ST1 PTC | N1K | Ni1000a Nickel(TCR) |
| passive temperature sensor output. Choose 'x' | A | 10K4A1 NTC | 50K | 50K6A1 NTC | TAC | 1K87A1 NTC |
| from the following table | Н | 20K6A1 NTC | J | 2.2K NTC | | |
| from the following table | D | 30K6A1 NTC | 100 | PT100a Platinum | | |

Installation

The transmitter should be installed by suitably qualified technician in conjunction with any guidelines for the equipment it is to be connected to and any local regulations. Field wiring should be installed to satisfy the requirements set out by the manufacturer of the equipment that the sensor is being connected to. Anti -static precautions must be observed when handling these transmitters. The PCB contains circuitry that can be damaged by static discharge.

The unit should not be mounted where temperatures will exceed the ambient temperature range specified.

Allow 2 minutes after applying power before checking functionality, and allow a further 10 minutes before carrying out pre-commissioning checks.

The sensor is designed for benign environments. The performance and reliability may be compromised in environments that contain corrosive or caustic gases including but not limited to Ammonia, Chlorine, NOx and Ozone. Care must taken to ensure that the sensor is not exposed to these compounds under any operating condition.

Location

Choose a location where the air is a representative sample of the area to be monitored or controlled. Install the sensor at a height of 1.5 to 2 meters, which is the breathing zone where most human respiration occurs. Place the sensor away from windows, doors, vents, and other sources of airflow that could skew readings. Ensure the sensor is in an open space for accurate measurements. Keep the sensor out of direct sunlight, as it can affect sensor readings. Exposure to direct sunlight can cause temperature fluctuations and impact performance.


Wiring

The transmitter should be connected to the controller using 0.5 to 1.5mm² cables. The use of a shielded cable is recommended for optimal noise immunity.

Power Supply: The transmitter can operate with both AC and DC power supplies. If a DC power supply is used, ensure it is galvanically isolated from the mains power. It can also be

powered by a step-down transformer if mains voltage is available. (Annicom recommends the use of a 5VA transformer.) Ensure that the device's maximum ratings are not exceeded. Excess voltage will result in permanent damage.

Outputs: Do NOT apply any external voltage to these terminals. The output configuration should be compatible with the device/ controller to which the unit is connected.



Output Configuration

Configure the CO2 sensing range and analogue outputs with the on board dipswitches. Possible configurations are shown below. Any other combination could cause device malfunctioning.

DSW1 - Configure CO2 output



ON - 5000ppm OFF-2000ppm



4-20mA Out



0-10V Out

DSW2 (optional)- Configure RH output





4-20mA Out



DSW3 (optional) - Configure temperature output



ON - Display on LCD



0-10V Out

AX-GS-CD-T81G

Room Carbon dioxide Transmitter, Analogue output, Optional RH&T



Enabling a combination of CO2,RH &T parameters result in toggling the values periodically.


Display (optional)

The -MCD versions come with a 4-digit, 9mm-high LCD display with a backlight that changes colours based on the detected CO2 level. By default, it displays the CO2 concentration in ppm.




In units with the optional RH and T sensor, the display will toggle between CO2, RH, and Temperature readings if the RH and T display is enabled with the corresponding dipswitches.

RH and Temperature disabled

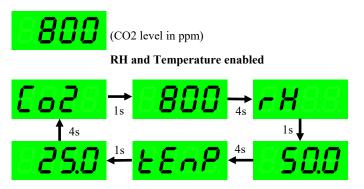


Dimensions

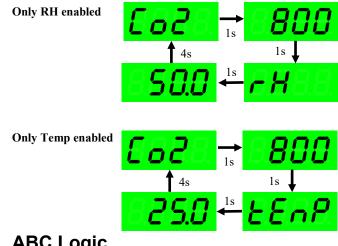

ABC Logic

Automatic Background Calibration Logic (ABC Logic) is a self-calibration technique designed for applications where concentrations drop to outside ambient conditions (ppm) at least once for 15 minutes within a 7-day period. This typically occurs during unoccupied periods. Full accuracy is achieved using ABC Logic. The sensor typically reaches its operational accuracy after 25 hours of continuous operation under conditions where it was exposed to ambient air at 400 ppm CO2. The sensor will maintain its accuracy specifications, provided it is exposed to the reference value at least once every 7 days, and this reference value is the lowest concentration to which the sensor is exposed. ABC Logic requires continuous operation of the sensor for increments of at least 4 hours each.

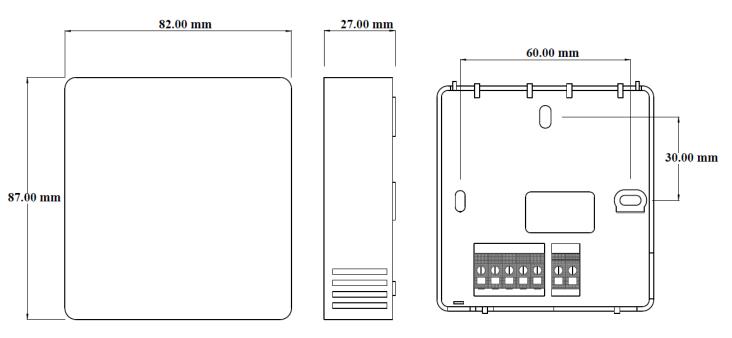

Datasheet Contents

Every effort has been taken in the production of this datasheet to ensure accuracy. Axio do not accept responsibility for any damage, expense, injury, loss or consequential loss resulting from any errors or omissions. Axio has a policy of continuous improvement and reserves the right to change this specification without notice.